

TEST CERTIFICATE

ST-24-03-26-02

Product: Coating "HSP-KERA TP/CP"
applied on: Variant 1 Thermo Pine Decking Boards
Variant 2 Larch Decking Boards

Producer: HSP-KERA GmbH
Industriestrasse 3
CH-9602 Bazenheid
Schweiz

Order: Determination of Slip Resistance of Floor Coverings -
Methods of Evaluation according to EN 16165:2021-10, Annex B
(Shod Ramp Test - Walking on an Inclined Walkway)


Test report: 2723317 dated 22/06/2023


Test results:

Variant	Property	Mean Angle of Slip α_{shod} in °	Anti-Slip Class according to DIN EN 16165:2023-02, National Annex NB (informative), Table NB.2
1	Slip Resistance of Floor Coverings according to EN 16165:2021-10, Annex B (Shod Ramp Test)	21,0	R11
2		18,3	R10

Dresden, 26/03/2024

p.p. R. B. 181
Head of laboratory

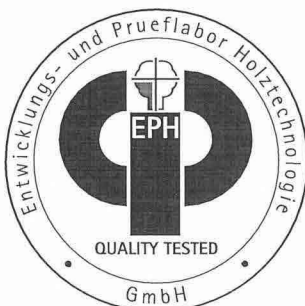


Engineer in charge